

PLANTA PAVIMENTO TERREO

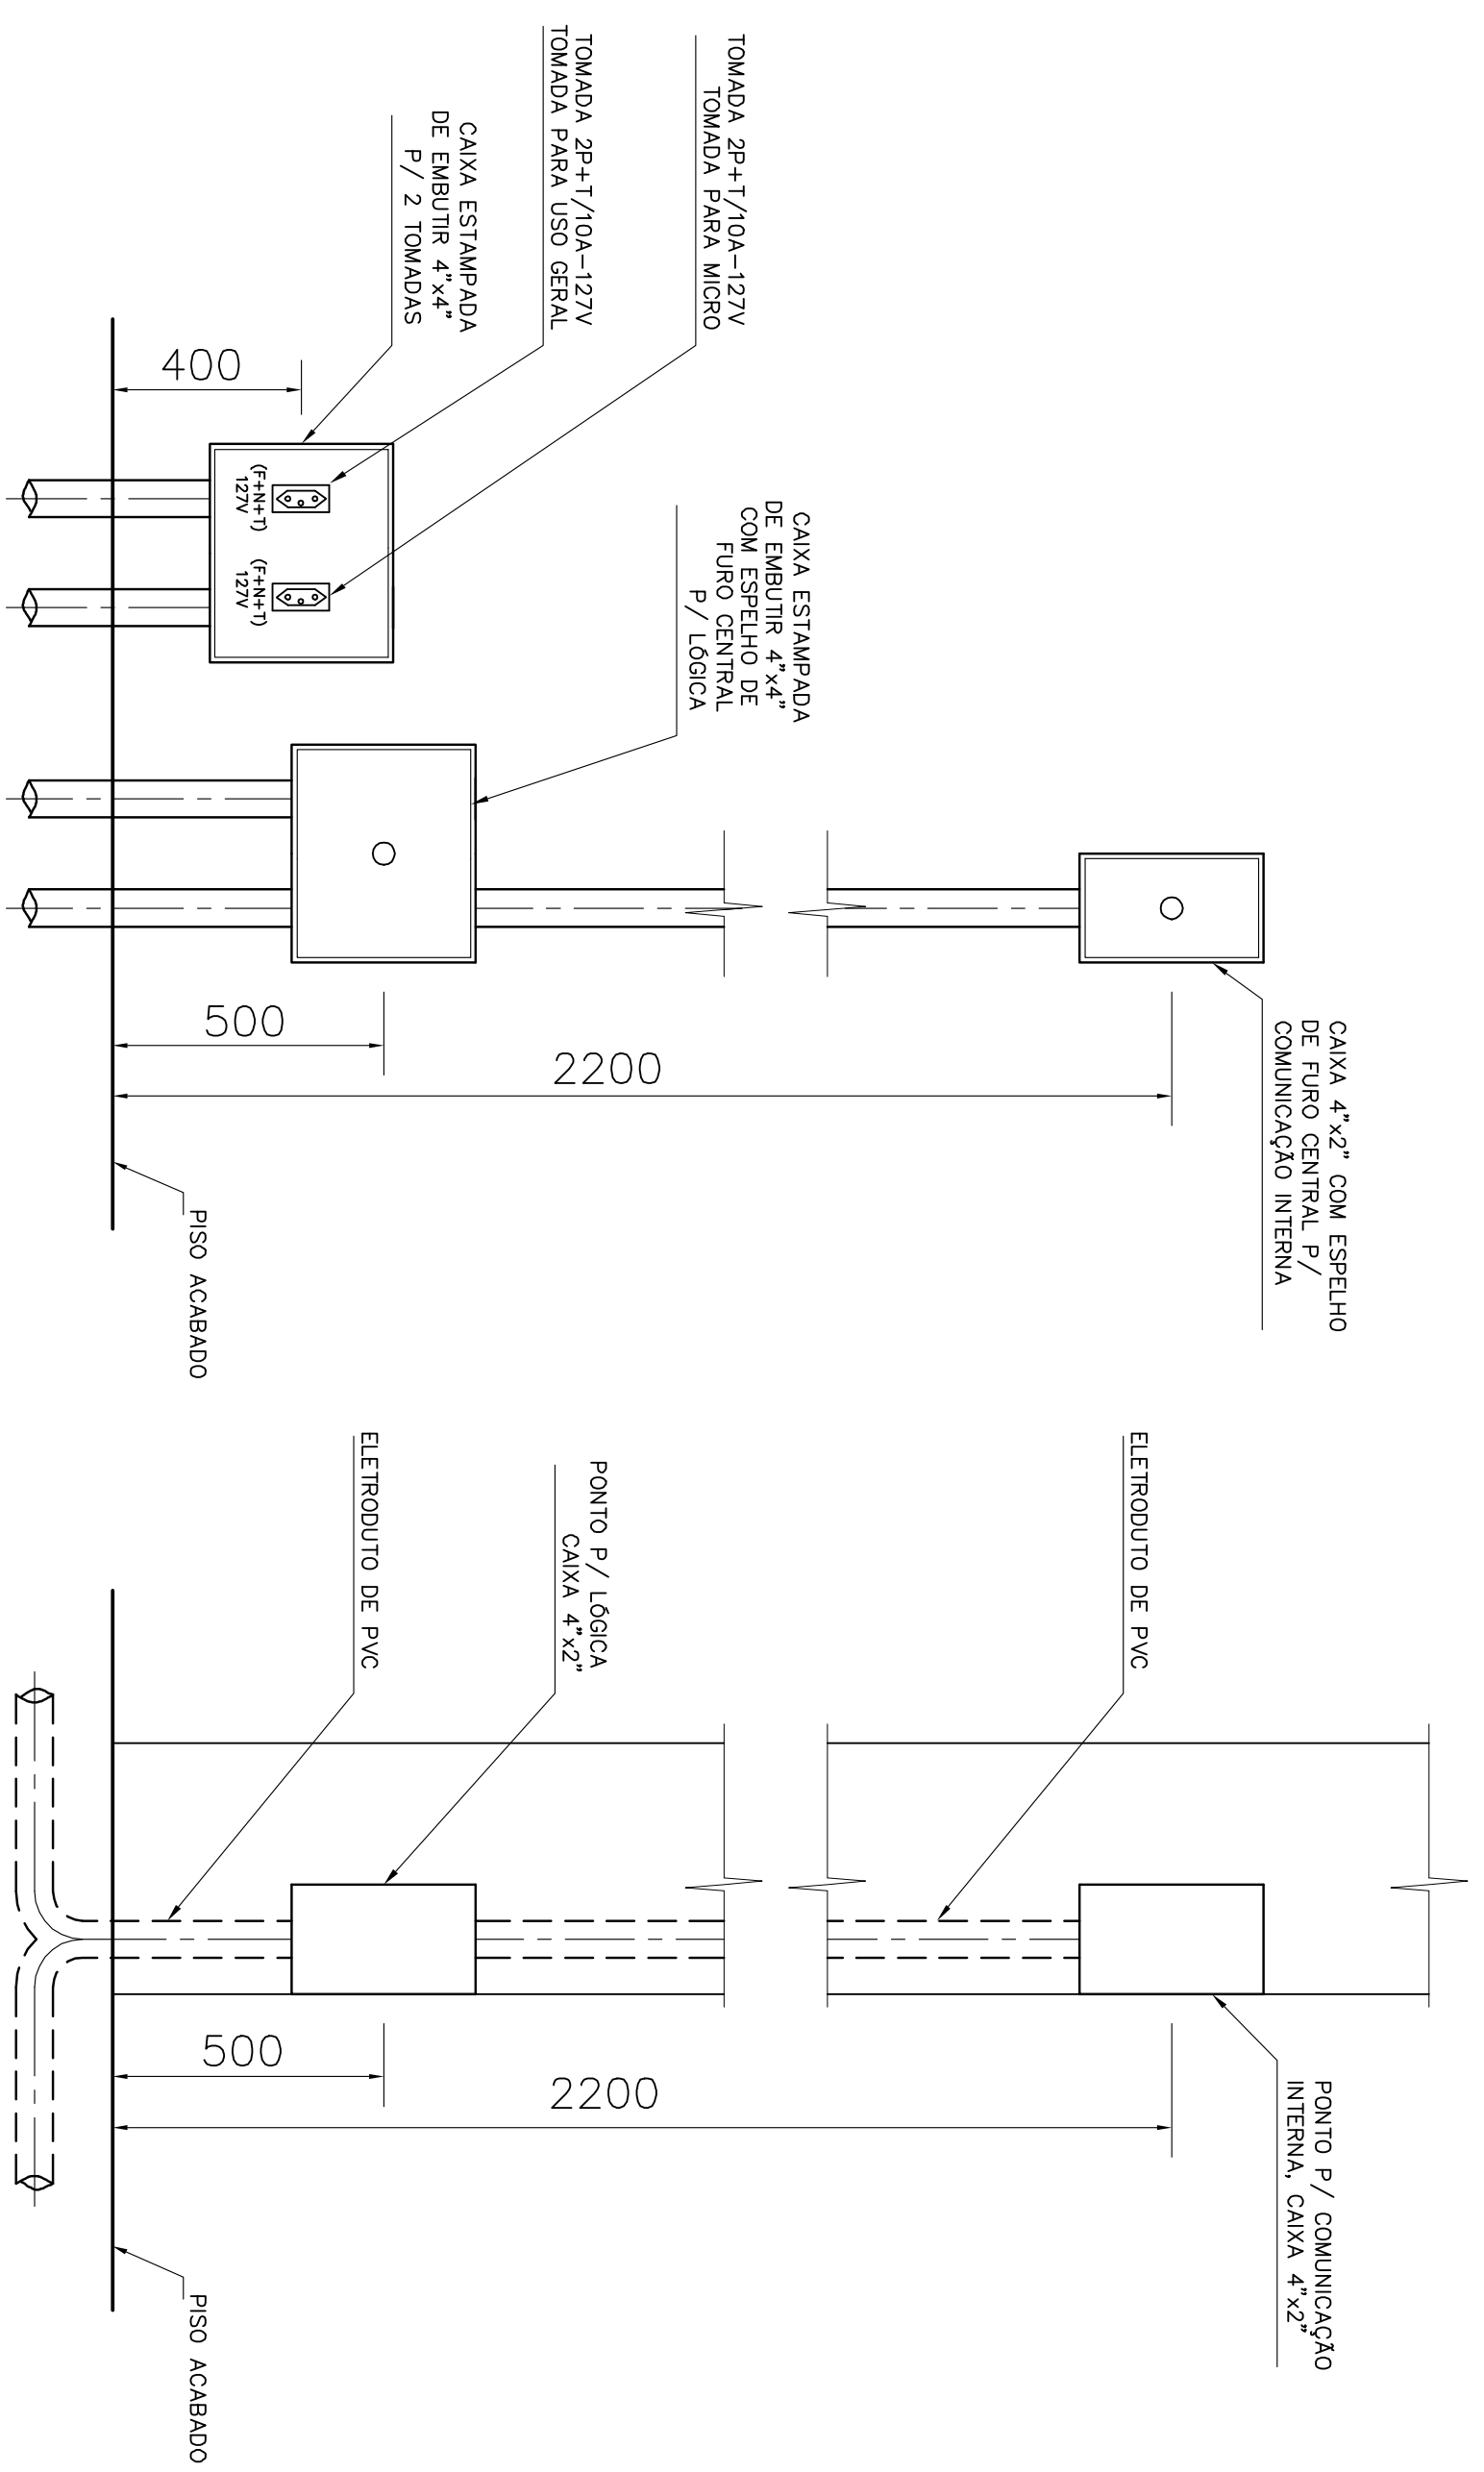


TABELA DAS CARGAS DO QUADRO QD-02 (SISTEMA DELTA COM NEUTRO 2F+N)

ORDEN	FOLIO	CARBON (VA)					CARGO PROI	OBSERVACIONES	
		ILUM	APAR	NOT.	TUS	TOTAL			
1	250	800	-	-	-	800	2,5	10	ILUM RETENOR (24,50W)
2	800	-	-	-	-	-	2,5	16	ILUM RETENOR (24,50W)
11	115	-	-	-	100	100	2,5	16	ILUM 100W
12	250	-	800	-	-	800	2,5	16	REFR/REFRER (400VA)
13	250	-	-	-	1200	1200	2,5	16	REF 500VA
14	115	-	-	-	1000	1000	2,5	16	REF 500VA
15	115	-	-	-	1000	1000	2,5	16	REF 500VA
16	250	-	400	-	-	400	2,5	16	EXAUSTOR
17	250	-	1800	-	-	1800	2,5	16	EXAUSTOR
18	250	-	1800	-	-	1800	2,5	16	EXAUSTOR
19	250	-	1800	-	-	1800	2,5	16	EXAUSTOR
20	115	-	600	-	600	600	2,5	16	ILUM DE PASAD. 600VA
21	115	-	230	-	-	230	2,5	10	ILUM DE PASAD.600-250W
22	115	40	-	-	-	40	2,5	10	ILUM DE PASAD.600-250W
TOTAL	-	1800	6720	-	4300	12820	23	80	

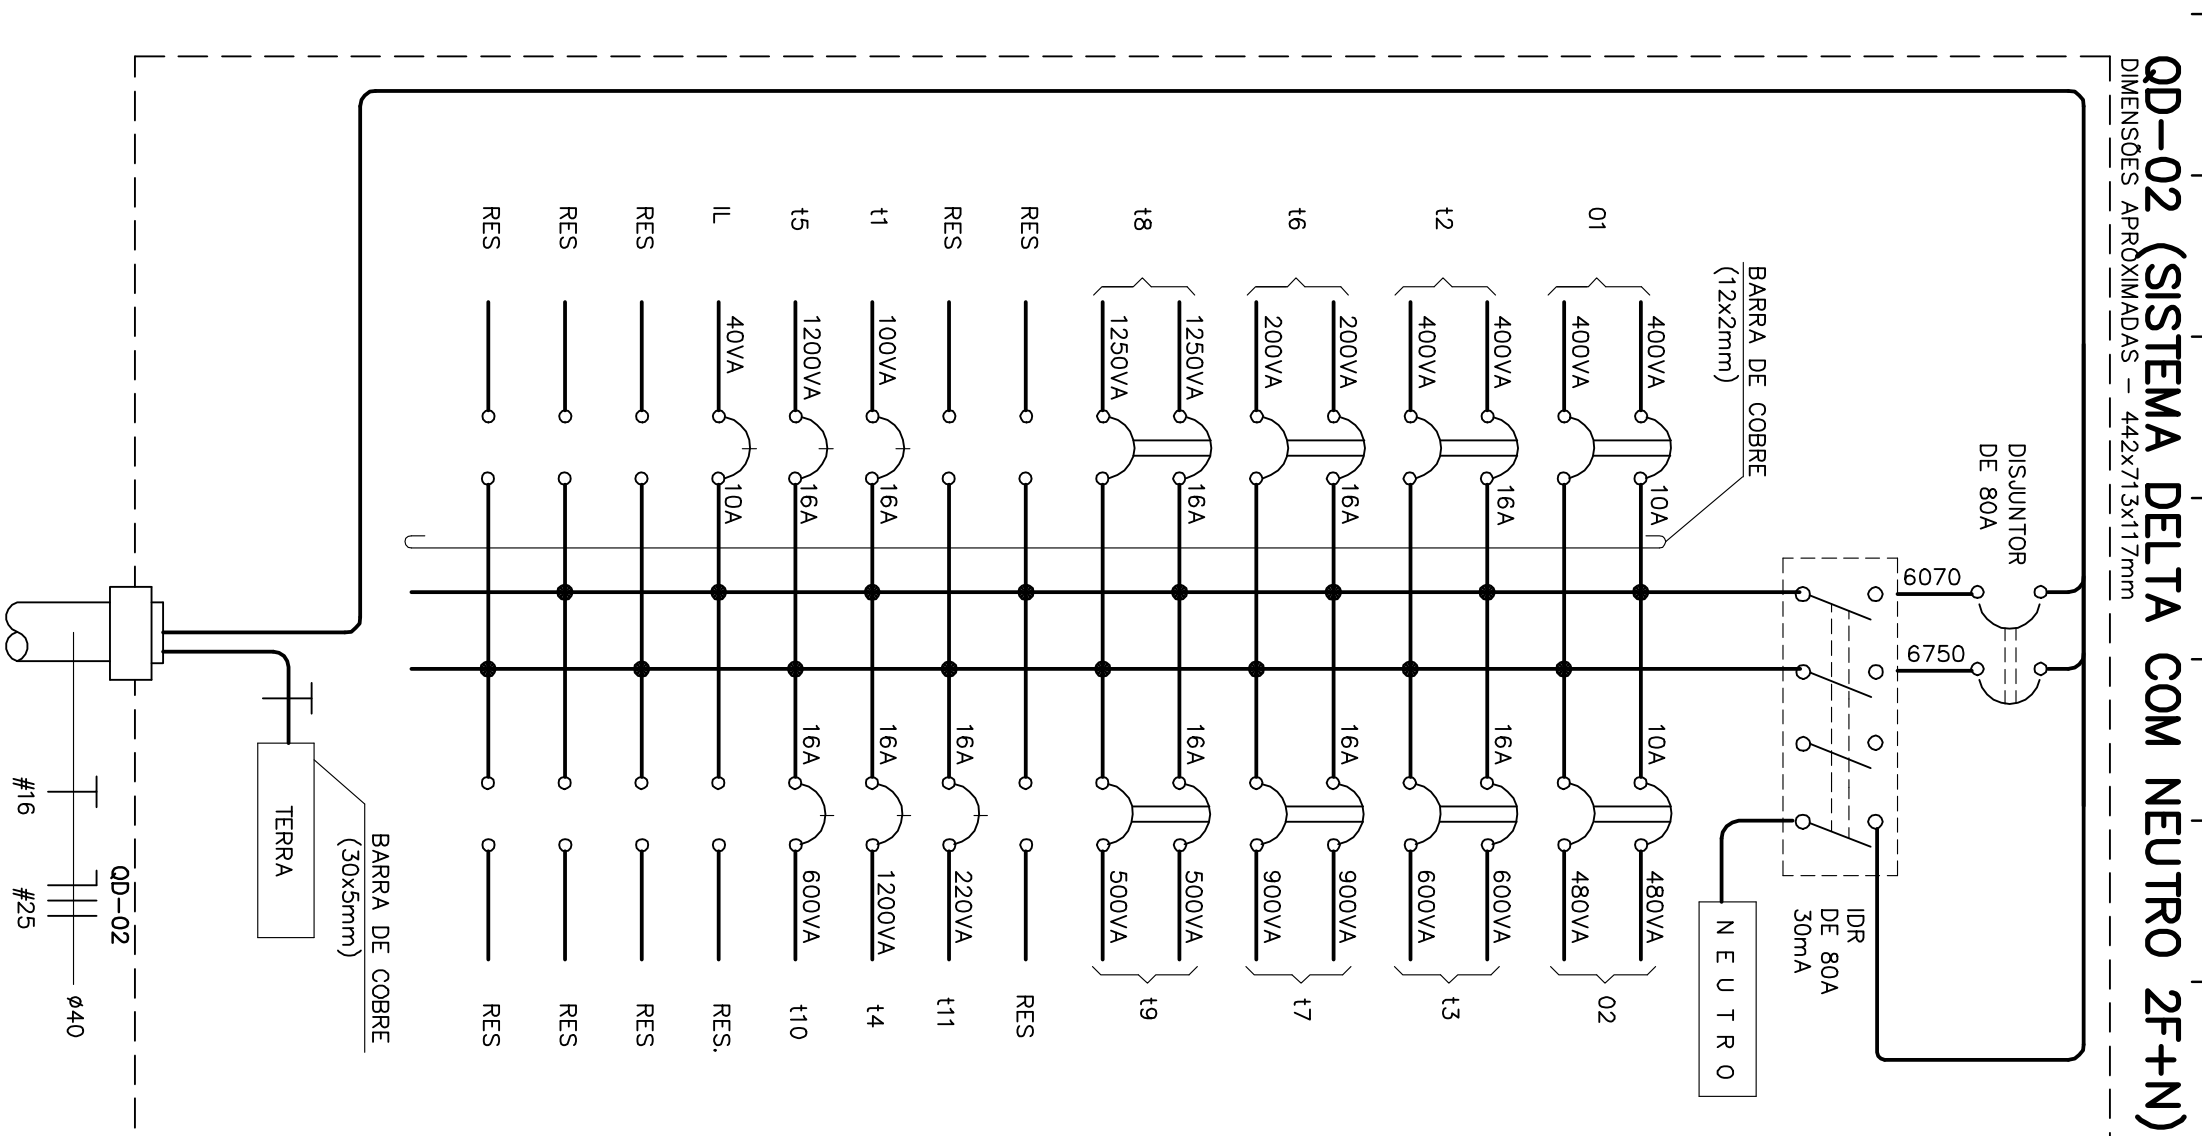


TABELA DAS CARGAS DO QUADRO QD-01 (SISTEMA DELTA COM NEUTRO 2F+N)

[illegible]